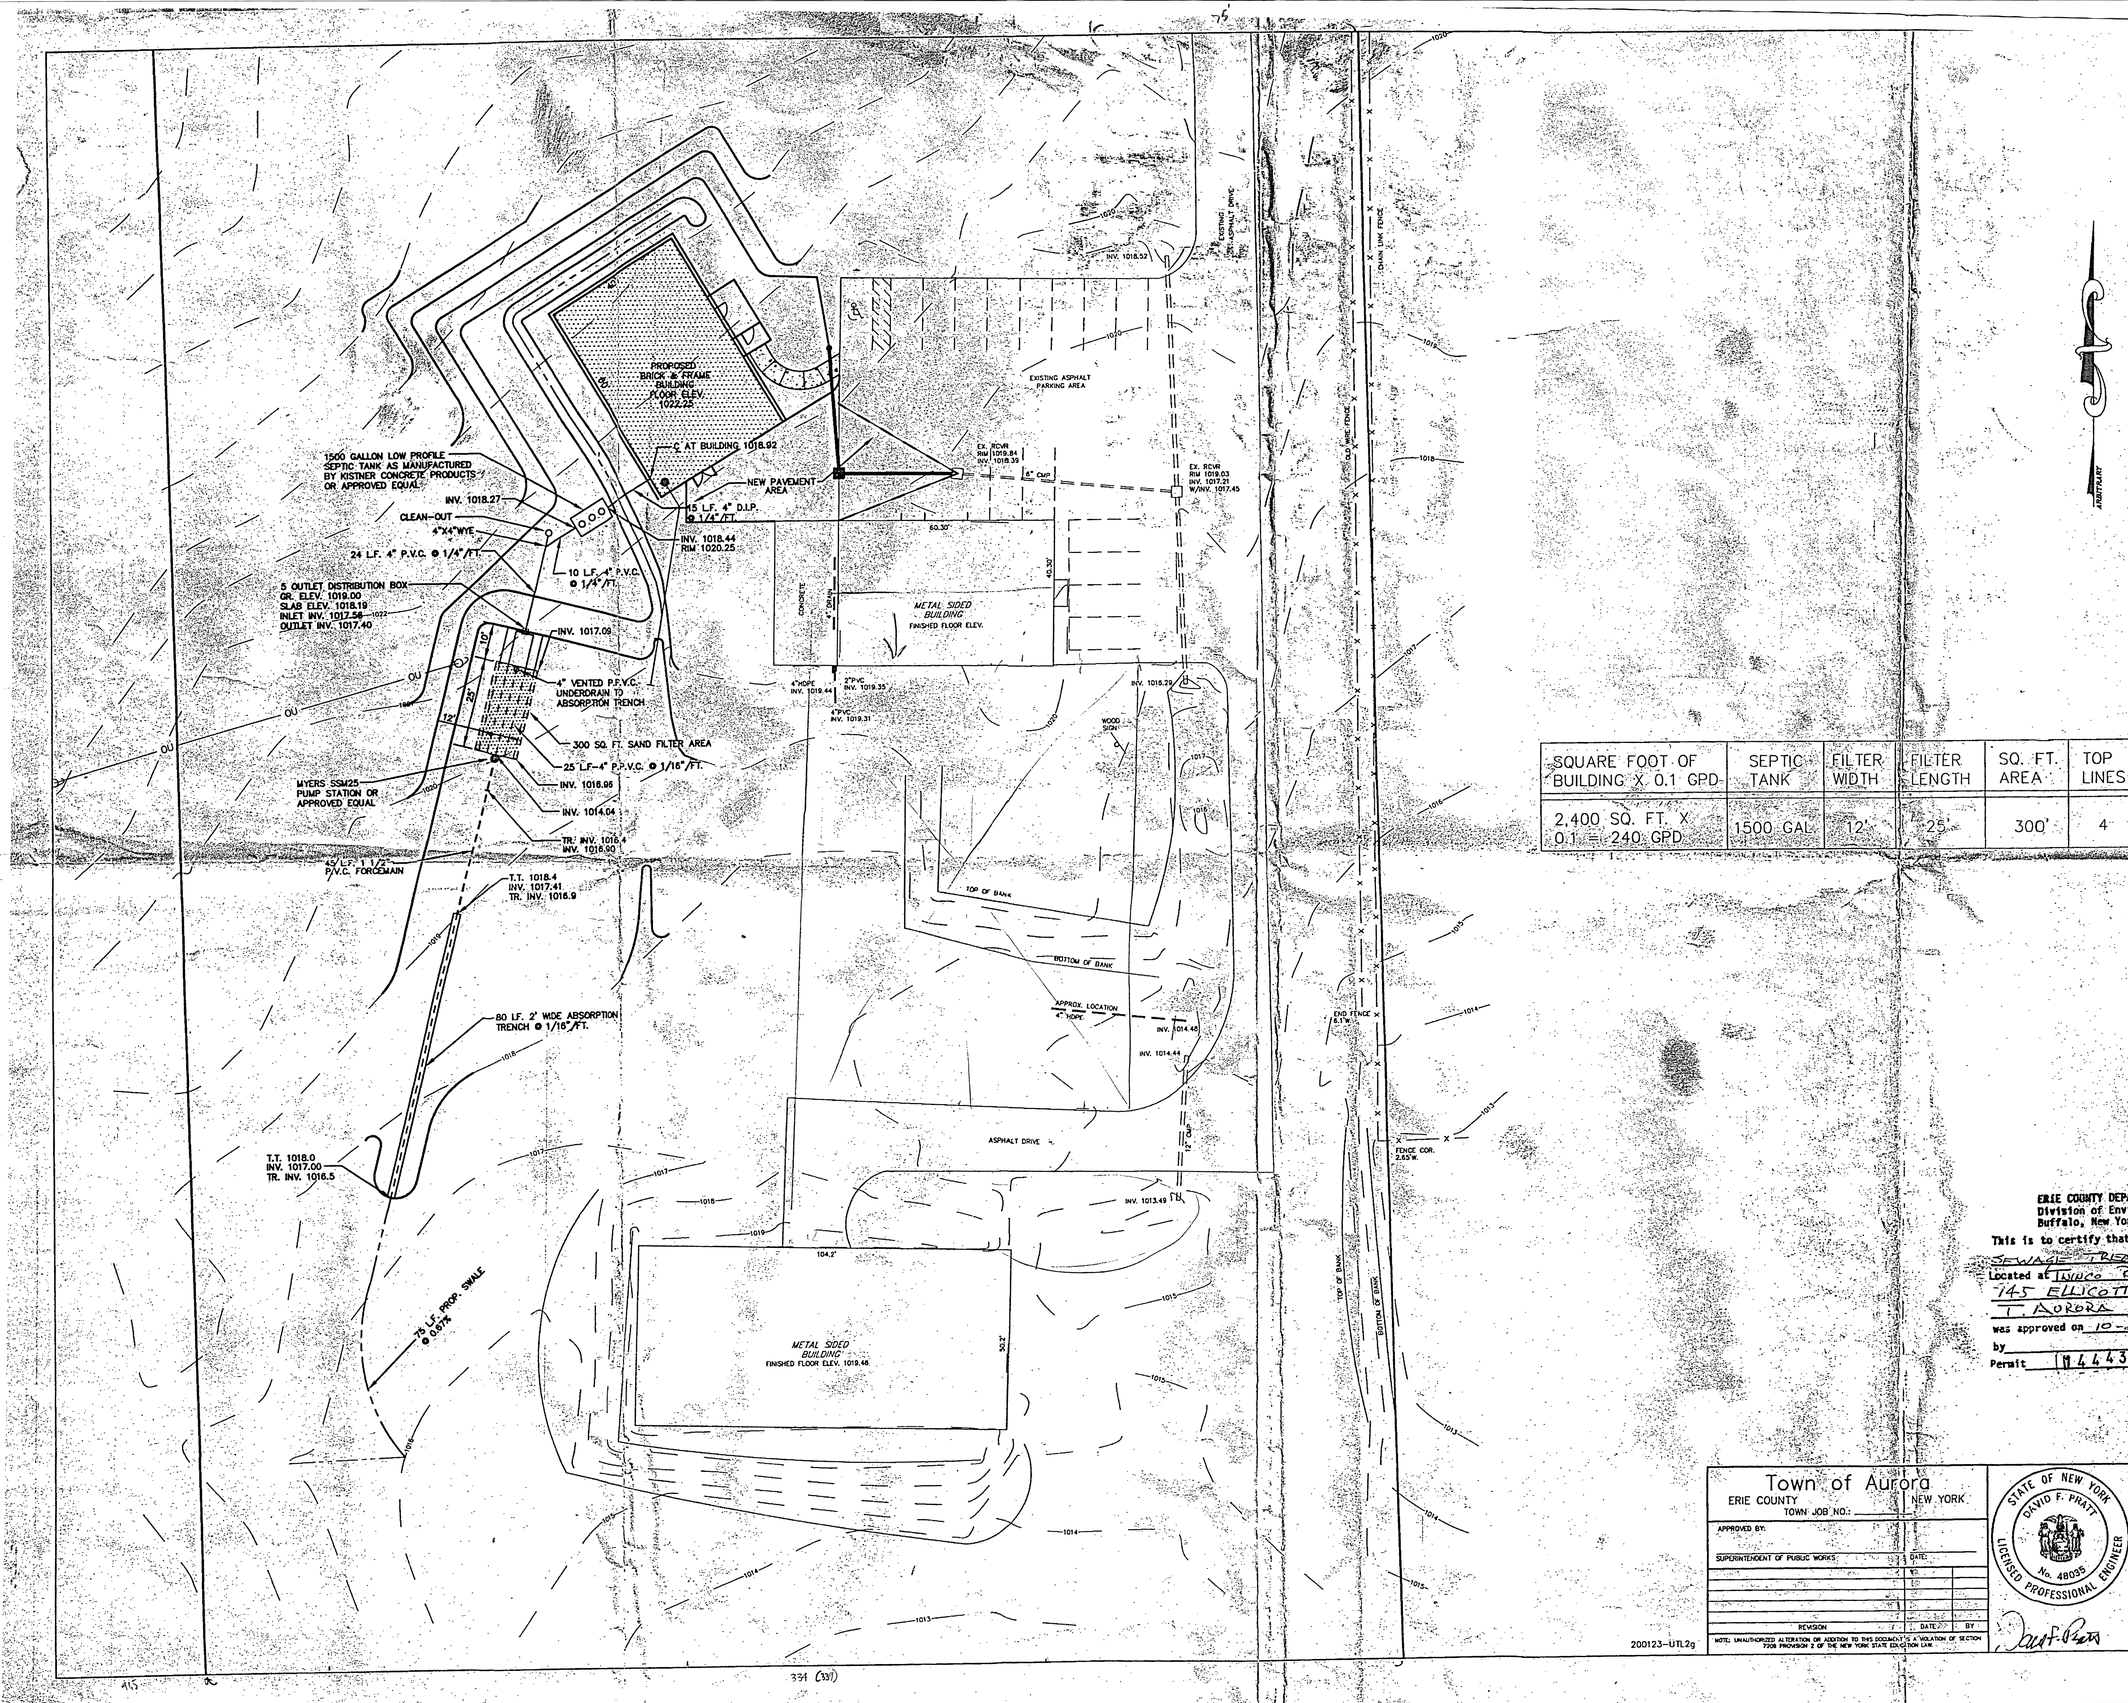

SQUARE FOOT OF BUILDING X 0.1 GPD	SEPTIC TANK	FILTER WIDTH	FILTER LENGTH	SQ. FT. AREA	TOP LINES	UNDER LINES	ABSORPTION TRENCH
2,400 SQ. FT. X 0.1 = 240 GPD	1500 GAL	12'	25'	300'	4	1	80'

ERIE COUNTY DEPARTMENT OF HEALTH
Division of Environmental Health
Buffalo, New York 10-25-2001

This is to certify that this plan for SEWAGE TREATMENT SYSTEM
Located at TWINCO BUILDING
145 ELLICOTT RD. in
T. AURORA Erie County
was approved on 10-29-2001
by P.H. Engineer
Permit #44431

PRINT ISSUED
OCT 22 2001

Town of Aurora
ERIE COUNTY NEW YORK
TOWN JOB NO.:

APPROVED BY:
SUPERINTENDENT OF PUBLIC WORKS DATE:

REVISION	DATE	BY

NOTE: UNAUTHORIZED ALTERATION OR ADDITION TO THIS DOCUMENT IS A VIOLATION OF SECTION 7209 PROVISION 2 OF THE NEW YORK STATE EDUCATION LAW.

STATE OF NEW YORK
DAVID F. PRATT
No. 48035
LICENSED PROFESSIONAL ENGINEER

TWINCO BUILDING
145 ELLICOTT ROAD
SANITARY SYSTEM

PRATT & HUTH ASSOCIATES, LLP
ENGINEERING • SURVEYING • PLANNING
4850 GENESEE STREET, SUITE 145 BUFFALO, N.Y. 14225
716-633-4844

DRAWN:	SLR	JOB NO.:	200123	SHEET NO.:
CHECKED:	DFP	DATE:	8/23/01	3 OF 7
APPROVED:	DFP	SCALE:	1"=20'	

200123-UTL2g

ENGNR